



INSTRUCTION BOOK

De-ion[®]
AIR CIRCUIT BREAKER
Type DH

—Westinghouse Electric Corporation—

I. B. 32-150-3A

Permission to use, copy and distribute the documentation published by Homewood Products Corporation on this World Wide Web server is hereby granted on the condition that each copy contains this copyright notice in its entirety and that no part of the documentation is used for commercial purposes but restricted to use for information purposes within an organization.

ALL INFORMATION PUBLISHED ON THIS WORLD WIDE WEB SERVER IS PROVIDED AS IS WITHOUT ANY REPRESENTATION OR WARRANTY OF ANY KIND EITHER EXPRESS OR IMPLIED INCLUDING BUT NOT LIMITED TO IMPLIED WARRANTIES FOR MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE OR NON-INFRINGEMENT. ANY HOMEWOOD PRODUCTS CORPORATION DOCUMENTATION MAY INCLUDE TECHNICAL INACCURACIES OR TYPOGRAPHICAL ERRORS. CHANGES AND ADDITIONS MAY BE MADE BY HOMEWOOD PRODUCTS CORPORATION FROM TIME TO TIME TO ANY INFORMATION CONTAINED HEREIN.

© Copyright 2001 Homewood Products Corporation. All rights reserved.

SPECIAL INQUIRIES

When communicating with Westinghouse regarding the product covered by this Instruction Book, include all data contained on the nameplate attached to the equipment.* Also, to facilitate replies when particular information is desired, be sure to state fully and clearly the problem and attendant conditions.

Address all communications to the nearest Westinghouse representative as listed in the back of this book.

WESTINGHOUSE	
METAL CLAD SWITCHGEAR	
DE-ION AIR CIRCUIT BREAKER DH	
STYLE OR SO	DATE OF MANUFACTURE
SERIAL	BREAKER UNIT & CODE
RATED KV	WILL FIT HOUSING CODE
MAX DESIGN KV	TYPE MECHANISM
AMPERES	CLOSING VOLTAGE
CYCLES	TRIPPING VOLTAGE
PATENTS 2442199 2276968 2243040 2242838 2242905 2177014	
• WESTINGHOUSE ELECTRIC CORP. • NPS4068-C MADE IN U.S.A.	

* For a permanent record, it is suggested that all nameplate data be duplicated and retained in a convenient location.



RECEIVING • OPERATION • MAINTENANCE

INSTRUCTIONS

De-ion[®]

AIR CIRCUIT BREAKER

Type DH

Horizontal Drawout

Indoor and Outdoor Service

AIR CIRCUIT BREAKER TYPE	3-PHASE INTER- RUPTING RATING MVA.	VOLTAGE RATINGS			AMPERES CONTIN- UOUS 60 CYCLES	INTERRUPTING RATINGS—AMPERES	
		Rated KV.	Max. Design KV.	Min. KV. for Rated INT. MVA.		At Rated Voltage	Max. Amperes
50-DH-150-D	150	4.16	4.76	3.5	600	21,000	25,000
50-DH-150-D	150	4.16	4.76	3.5	1200	21,000	25,000
50-DH-150-D	150	4.16	4.76	3.5	2000	21,000	25,000
50-DH-250-D	250	4.16	4.76	3.85	1200	35,000	37,500
50-DH-250-D	250	4.16	4.76	3.85	2000	35,000	37,500
75-DH-250-A	250	7.2	8.25	4.6	1200	20,000	32,000
75-DH-250-A	250	7.2	8.25	4.6	2000	20,000	32,000
75-DH-500-A	500	7.2	8.25	6.6	1200	40,000	44,000
75-DH-500-A	500	7.2	8.25	6.6	2000	40,000	44,000
150-DH-150-A	150	13.8	15.0	6.6	600	6,300	13,000
150-DH-150-A	150	13.8	15.0	6.6	1200	6,300	13,000
150-DH-250-A	250	13.8	15.0	6.6	1200	10,600	22,000
150-DH-250-A	250	13.8	15.0	6.6	2000	10,600	22,000
150-DH-500-A	500	13.8	15.0	11.5	1200	21,000	25,000
150-DH-500-A	500	13.8	15.0	11.5	2000	21,000	25,000

WESTINGHOUSE ELECTRIC CORPORATION
SWITCHGEAR DIVISION

EAST PITTSBURGH PLANT


EAST PITTSBURGH, PA.

SUPERSEDES I.B. 32-150-3

MAY, 1953

Printed in U.S.A.

(Rep. 10-59)

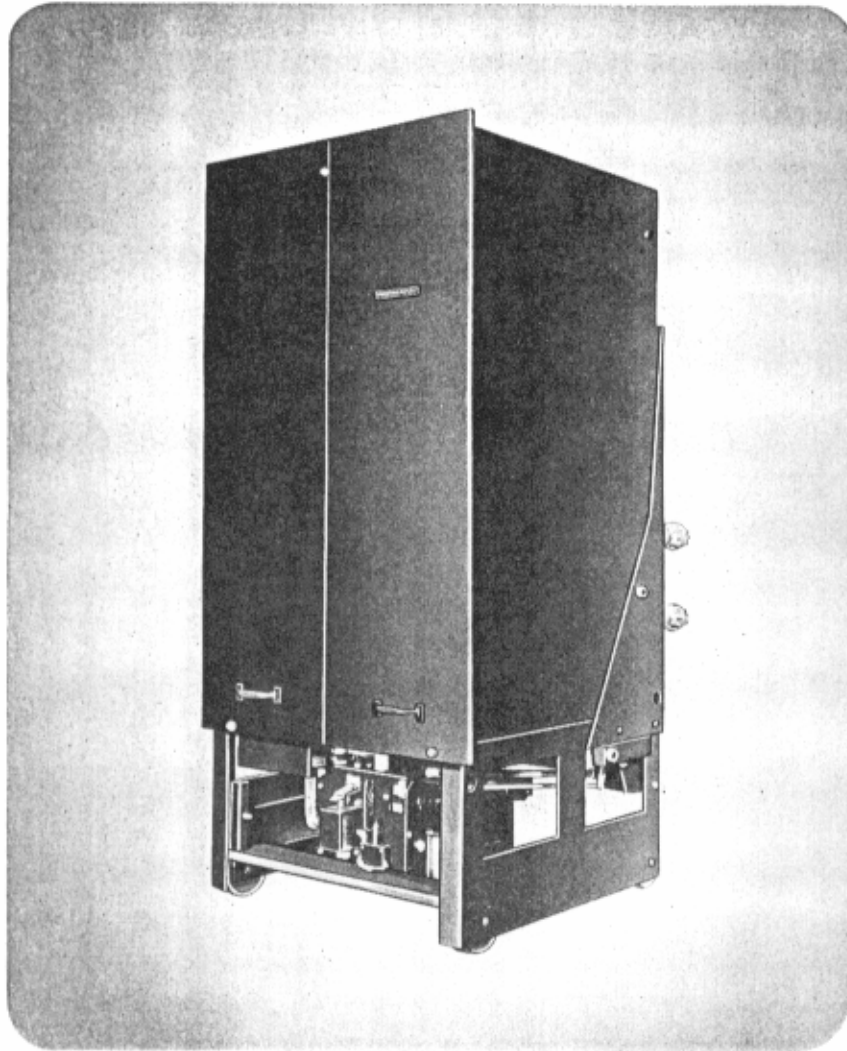

One of the outstanding improvements in modern power distribution has been the development of the air circuit breaker by Westinghouse for distribution circuit voltages. On circuits where the duty on breakers is heavy, long life with a minimum of maintenance makes the De-ion air breaker an outstanding performer. In the type DH magnetic De-ion air circuit breakers, Westinghouse offers a complete standard line for circuits from 2.3 to 15 kv.

Each of the type DH air circuit breakers is three-pole, electrically operated, and is built as a complete horizontal drawout unit for metal-clad switchgear. Breaker units of the same rating are interchangeable so that changing breakers is a matter of minutes. Since they are drawn out horizontally, no lowering or lifting is necessary. Steel barriers and automatic interlocks prevent contact with live parts while the breakers are being changed.

As in the case of most high voltage electrical equipment, these breakers should be inspected and maintained at regular intervals in order to obtain the most dependable performance.

DESCRIPTION

The type DH air circuit breaker is a three-pole, electrically operated, horizontal drawout unit for metal-clad switchgear. In the type designation, the numbers preceding DH indicate the voltage rating in hundreds of volts, and the numbers following DH indicate the maximum interrupting rating in thousands of kva. The various ratings have similar structural features and many parts in common.

Fig. 1 shows a type-150-DH-250A breaker with the main barrier assembly and one arc chute removed. This shows clearly the arrangement of the arc chutes and blowout magnet assemblies, the contacts and insulated operating rods, and the solenoid operating mechanism. These components are supported in a welded steel frame mounted on flanged wheels for guiding it into the metal-clad cell. In the lower part of the frame also is located the levering-in device for moving the breaker into final contact engagement. This device is interlocked with the mechanism to prevent inserting or withdrawing the breaker with the contacts closed. Also located in the lower part of the frame are the secondary contacts for automatically disconnecting the control wiring when the breaker is withdrawn, the auxiliary switch, and other auxiliary devices.

A barrier assembly is placed on the breaker before it is rolled into its cell. The front sheet is of one-eighth inch steel to form a grounded barrier between personnel and live parts when the unit is in the cell. On 15 kv breakers this barrier assembly is in two parts for convenience in handling.

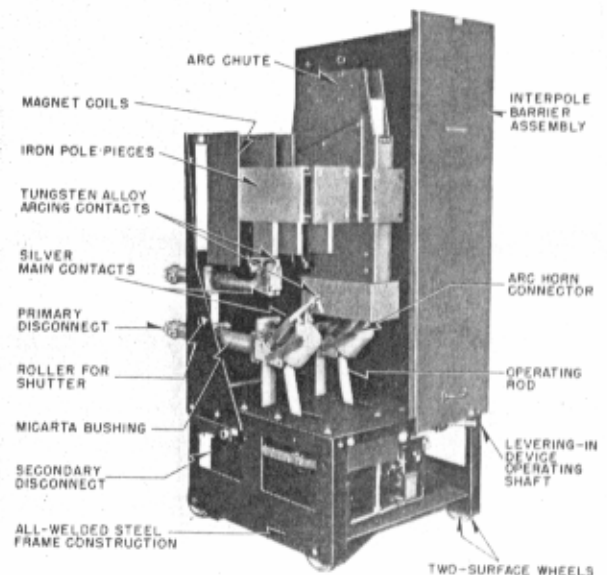


FIG. 1. Type 150-DH-250A Circuit Breaker with Half of Main Barrier and One Arc Chute Removed

RECEIVING, HANDLING, STORING

All type DH breakers are assembled and given operating tests at the factory, after which they are carefully inspected and prepared for shipment by workmen experienced in the proper handling and packing of electrical equipment. In order to afford maximum protection against damage, the main barrier assembly and the arc chutes are packed separately. For each three-pole breaker there is one barrier assembly and three arc chutes.

After the equipment has been unpacked, make a careful inspection for any damage which may have occurred in transit. If the apparatus has been

damaged, file a claim immediately with the carrier and notify the nearest Westinghouse Sales office.

HANDLING

Remove the crating and packing carefully to avoid damage from negligent handling of crowbars or other tools. Use a nail puller for the uncrating. Care must be used in handling the arc chutes, since the splitter plates within them are made of a ceramic material which may break if dropped.

The base of the crate may be used as a skid for moving the breaker, or the breaker may be lifted

RECEIVING, HANDLING AND STORING

with slings under the crate. If the breaker is to be lifted with slings, move it while it is still crated. After the breaker is unpacked, the best way to move it is by rolling it on its own wheels.

If it is necessary to lift the breaker after it is uncrated, lift it without the arc chutes or barriers in place. Slings may be placed under the breaker frame or in holes provided in the frame. Use a spreader to prevent the cables from distorting the blowout magnets.

STORING

The arcing chambers are shipped in separate containers to guard against damage from rough handling and for better protection from dust and water or liquids. Store them in their shipping containers until ready for use.

Store all components of these breakers in a clean dry place. During the storage period, keep them sufficiently warm to prevent moisture condensation.

TABLE OF APPROXIMATE WEIGHTS
(In Pounds)

BREAKER TYPE	AMPERE RATING	BREAKER WITHOUT CHUTE & BARRIER	SINGLE ARC CHUTE	BARRIER ASSEMBLY	COMPLETE BREAKER
50-DH-150-D	600-1200	875	45	75	1085
50-DH-150-D	2000	1050	45	95	1280
50-DH-250-D	1200	875	45	75	1085
50-DH-250-D	2000	1050	45	95	1280
75-DH-250-A	1200-2000	1400	65	160	1750
75-DH-500	1200-2000	1600	105	160	2075
150-DH-150-A	600-1200	1250	70	160	1620
150-DH-250-A	1200	1250	70	160	1620
150-DH-250-A	2000	1400	70	160	1770
150-DH-500-A	1200	1450	105	160	1925
150-DH-500-A	2000	1600	105	160	2075

INSTALLATION

With the exception of the arcing chambers and barriers, these breakers are shipped completely assembled and adjusted. No adjustments should be required and none should be made unless obviously needed.

When the breaker has been removed from the crate, remove braces which support the blowout magnet pole pieces during shipment.

Caution: Severe injury may be sustained if any part of the body is struck by the contact arms since they move very rapidly on the opening stroke. Personnel working about the breaker should stay clear of the space in which the contact arms move while breaker is closed or is being closed. If breaker has been closed by hand, always remove hand closing lever before tripping.

The following sequence of operations should be performed in preparing the breaker for use:

1. Breakers are usually shipped with the contacts closed and with a tie on the trip lever to pre-

vent tripping. After the breaker is unpacked and the shipping ties and braces removed, take off the tie on the trip lever and trip the breaker. Then close the breaker carefully by hand, using the removable hand closing lever. Make certain that all parts are functioning properly and that there is no binding or excessive friction. As the contacts touch near the end of the closing stroke, the force necessary to close the breaker increases rapidly.

2. With the breaker in the closed position, check the contacts to make certain that the adjustments have not been disturbed. For proper settings, refer to the section of Fig. 6 which matches the contact design of the breaker being installed. If adjustments are required, they may be made as described on page 9.

A light film of grease is applied to both the arcing and main contacts before the breaker is operated at the factory. This film is normally removed before shipment. Before the breaker is placed in service, inspect all contacts to see that they are free of oil or grease.

3. The breaker is more easily handled with the arc chutes and barriers removed; mount these parts after the breaker has been moved near the metal-clad cell structure.

Before installing the arc chutes, play a stream of dry compressed air through them from each end to remove any dust or foreign matter. Then examine the chutes to make certain that the vents and slots are open and free from foreign material. Assemble the arc chutes on the breaker by removing the retaining straps from the front of the magnet pole pieces and sliding the chutes into position, making sure that the rear arcing horn connectors properly engage the contacts on the blowout coils.

After a chute has been placed in position, make sure (1) that it is centrally located so that there is no interference with the travel of the moving contacts and (2) that it is securely held in position by the retaining strap with top of the chute parallel to the top of the laminated pole faces. Connect the shunt strap to the front arcing horn in the chute. Tighten the lower connection of the shunt strap since it may have loosened during transit. The arc chute is now completely installed. Make a final check by operating the breaker slowly by hand to see that there is no interference in the movement of the moving contact.

4. The interpole barrier assembly should now be put in place. The 5 kv breakers have a one piece assembly. Blowout magnet micarta channels have their front edges beveled to help guide barrier plates into place. The lower rear corner of the outside micarta plate goes inside the steel gusset of the frame. The front steel sheet of the barrier assembly is centered on the breaker by a notch on the bottom edge at the middle, which should engage a locating pin on front edge of breaker frame. Two bolts at lower front corners hold assembly in place.

Because of size and weight the interpole barrier assembly on the 15 kv breakers is divided in two parts. Right half goes on first. The front steel sheets are aligned by two locating pins at lower front corners and single bolt at top center. Two bolts at lower front corners hold assembly in place.

5. The breaker is now ready to be operated electrically. Each breaker should be closed and tripped electrically several times before being connected to high voltage. These operations may be made at the test position in the cell or by means of other test facilities provided. See page 12 of this instruction book and I.B. 32-150-4, page 33, for information concerning placing the breaker in the cell. The hand closing lever must always be re-

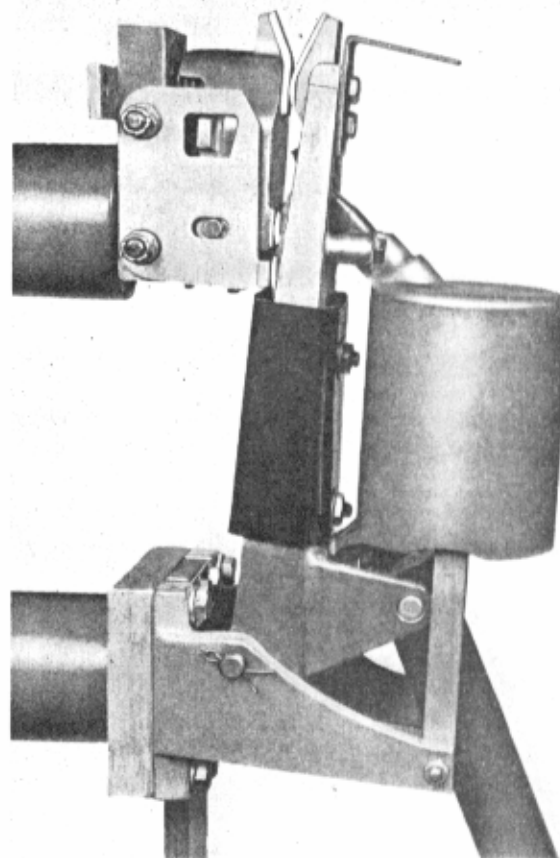


FIG. 2. Typical Contact Assembly Shown in Closed and Latched Position

moved from socket in mechanism before making electrical operation. If electrical operation is quick and positive on both close and open, breaker is now ready to be levered into operating position.

Caution: Do not attempt to close by hand, against an energized circuit, any breakers covered by this instruction book. To insure sufficient closing force and speed, these breakers should be closed electrically from an adequate power source. See NEMA Standard SG 6-213.

When this drawout equipment is put into the cell and moved in beyond the test position, the high voltage parts of the breaker will be energized. If the barrier is completely assembled on the breaker, personnel will be protected from contact with the live parts. If, however, the barrier assembly is left off and the breaker rolled into the cell, live parts are exposed. The breaker should never be rolled into an energized cell structure beyond the test position without having the complete barrier assembly in place.

OPERATION AND ADJUSTMENT

Before adjusting a circuit breaker, it is advantageous to become familiar with the construction and function of the various parts. The following paragraphs describe the operation and the various adjustments which can be made. This material should be studied carefully before doing any work on the breaker.

The general arrangement of the breaker components is shown in Fig. 1. The solenoid coil is built to exert a horizontal force on the mechanically-trip-free linkage. This linkage, in turn, exerts an upward force on the pole unit insulating operating rods. The moving contact arms carry the main, intermediate, and arcing contacts. On opening, these contacts separate in the order named; on closing, they touch in the reverse order.

On the outer ends of the condenser bushings are clusters of finger contacts for engaging the main circuit contacts in the cell. Above the arcing contacts are located the blowout magnets and arc chutes. The breaker is tripped by lifting the tripping trigger either manually, or electrically by means of the trip coil.

OPERATING MECHANISM

The solenoid operating mechanism with its trip-free linkage is shown in Fig. 4. In this mechanism the horizontal pull of the solenoid coil is transmitted to the contact operating rods through a system of links which rotates counter-clockwise about the operating center. The linkage system consists of four major links: the non-trip free lever, trip free lever, upper trip free link, and lower trip free link. These members are arranged as shown and are held to form a rigid member by the cam link and tripping cam. The tripping cam is held fixed by the tripping latch.

When the solenoid is energized, it pulls on the junction of the non-trip free lever and the lower trip free link, causing the system to rotate about the operating center. The trip free lever then exerts an upward force on the operating rods through the cross bar to close the breaker. The breaker is held in this position by the closing latch and the tripping latch.

The breaker is tripped either electrically or manually by lifting the trigger which disengages the primary latch. This allows the tripping latch to release the tripping cam so that it is free to rotate. Without the restraining force of the cam and cam

link, the major linkage collapses under the force of the contact springs and the accelerating springs which are located in an air bumper attached to the trip free lever. The junction of the upper and lower trip free links moves to the right and the trip free lever rotates clockwise, thus opening the breaker. The position of the linkage is then that shown in Figure 4-B.

In moving to this position the roller on the lower trip free link has disengaged the closing latch. The retrieving springs now move the solenoid core which moves the linkage to the reset position as shown in Figure 4-C. In this position the tripping latch is reset and the breaker may be reclosed.

MECHANISM PANEL

The mechanism panel is mounted on the front of the closing solenoid mechanism as shown in Fig. 3. On it are mounted the following auxiliary devices included as standard on all breakers:

Shunt Trip Magnet. This device may be equipped with a coil for direct current or alternating current or capacitor tripping.

Cut-Off Switch. This switch causes the supply to the closing solenoid to be cut off after the breaker is closed.

Position Indicator. This device gives positive indication of the position of the breaker contacts.

Operation Counter. This counter records each operation of the breaker.

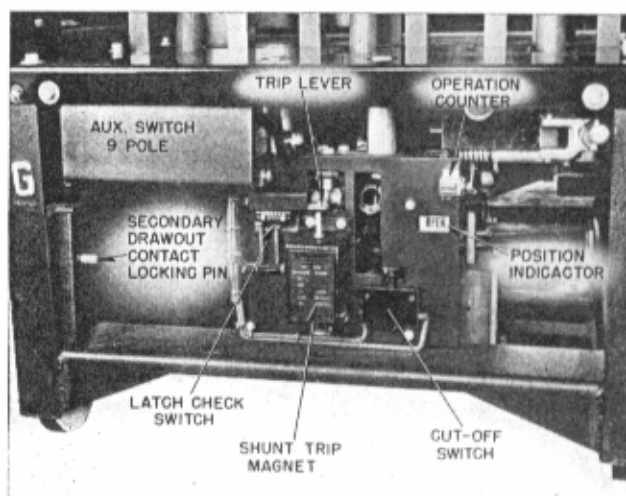


FIG. 3. Mechanism Panel

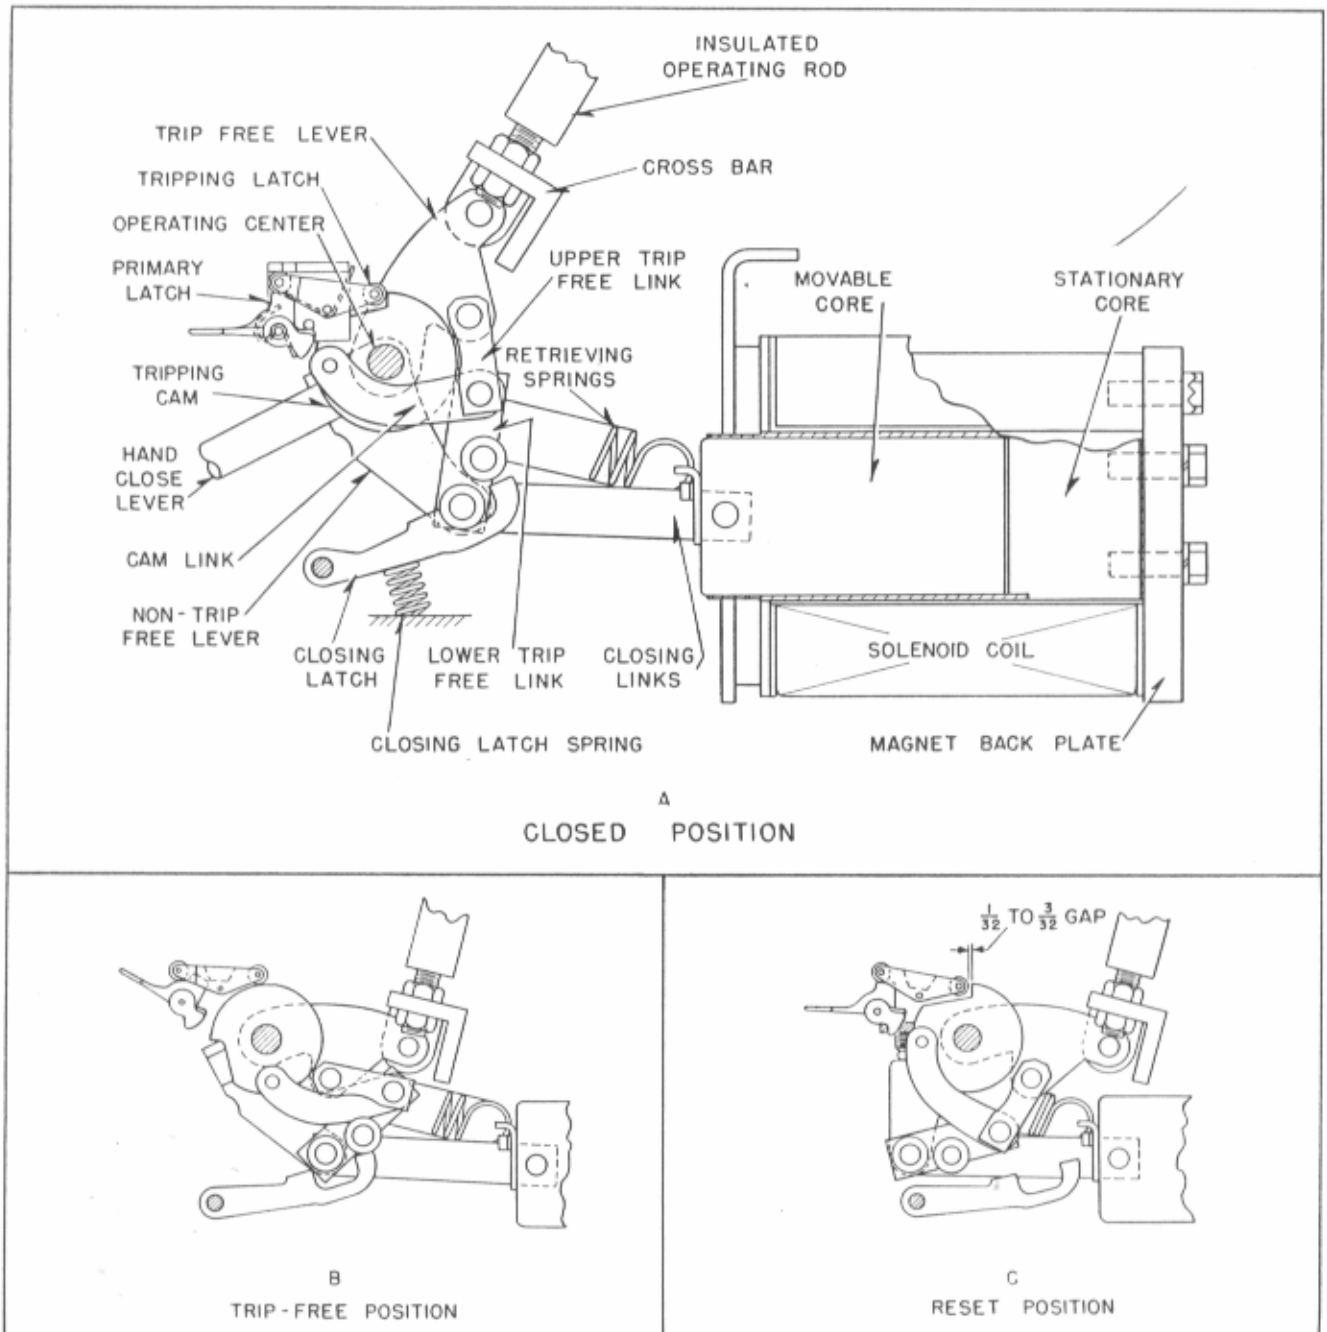


FIG. 4. Solenoid Operating Mechanism

The following special devices may also be mounted on the mechanism panel when required:

Undervoltage Trip Attachment. This is a magnetically held device which when released will trip the breaker using energy stored in a spring during the mechanism retrieving motion. For instantaneous release, the holding magnet coil may be connected to d-c with a series resistor to suit the voltage or it may be supplied with low voltage d-c from an a-c control voltage through a small

transformer and rectox assembly mounted in the cell structure. For time delayed release, a special very high resistance coil is used in the holding magnet and it is supplied with about 300 volts d-c from a transformer, rectox, and capacitor assembly mounted in the cell. The capacitor is connected across the coil and provides a slowly decaying holding current. See Descriptive Data sheet 33-131. The holding magnet is mounted on the mechanism panel to the left of the shunt trip magnet.

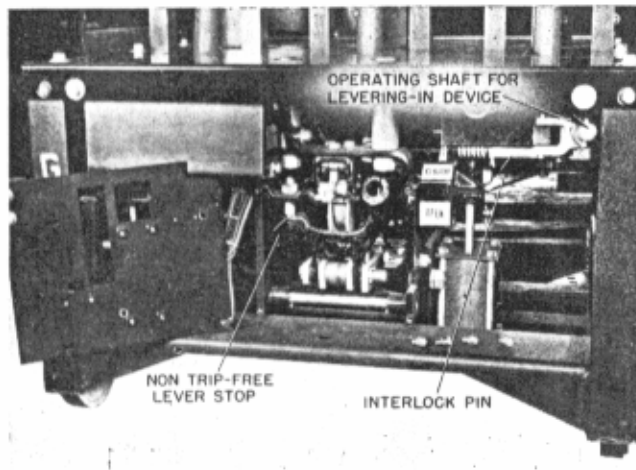


FIG. 5. Operating Mechanism—Panel Removed

Latch Check Switch. When a breaker is to be automatically reclosed after being tripped free, it is necessary to arrange the electrical control scheme so that the closing solenoid will not be energized to start the closing motion until the mechanism has completed the linkage motions to get to the reset position. See "B" and "C" of Fig. 4. For this purpose, a switch is arranged to be closed when the primary latch or trigger handle moves to the reset position because the trigger is the last part to move in the sequence of linkage motions required to reset the mechanism. To keep necessary tripping force small, the resetting spring torque used on the trigger is small. Therefore, the latch check switch is a small, light force, snap action switch. See Fig. 3.

MECHANISM ADJUSTMENTS

The mechanism in the Type DH air circuit breaker is adjusted at the factory and is designed to give long trouble-free performance. Do not make any adjustment unless faulty operation is observed.

Tripping Latch. If a breaker fails to close contacts although the moving core of the mechanism moves to the closed position, a probable cause is failure to reset. Refer to "C", Fig. 4. The gap indicated between tripping latch roller and cam is an essential requirement to permit tripping latch roller to fall into cam notch. Watch trigger handle (with words "lift to trip"). It should return to horizontal position, immediately after breaker has opened.

If trigger is prevented from returning to full reset condition by primary latch roller above it, cause

may be that tripping latch roller cannot drop into cam notch. Remove front half of horizontal panel forming seat of the chair in the frame. This gives easy access to the gap. Using hand closing lever, close breaker part way, trip, and then slowly retrieve moving core. Note whether or not tripping latch roller drops into cam notch.

If necessary to increase clearance to get $\frac{1}{32}$ inch minimum, remove front panel as follows. Remove spring from operating arm of counter. Remove four bolts and then turn panel as though hinged at left edge to prevent damage to wiring. Set out of way as shown on Fig. 5. There is no need to remove wiring. The non trip free lever stop is now accessible. Loosen lock nut and adjust stop bolt until cam to roller clearance is within limits. Hand closing lever should be out of socket during this adjustment. When returning panel, be sure to get cutoff switch arm into correct position through window.

Cut-Off Switch. Operation of this switch must occur at proper time in closing stroke. Contacts must make positively before end of motion so that current will always be cut off. In other direction, cut off must not occur too early in stroke or mechanism might fail to complete closing stroke. Proper action will be obtained when switch plunger has $\frac{1}{32}$ to $\frac{1}{8}$ -inch overtravel. In other words, between position where contacts touch and position with breaker closed and latched at rest, there should be $\frac{1}{32}$ to $\frac{1}{8}$ inch motion of switch plunger. Ordinarily no adjustment is required. The resilience provided in the operating arm, by leaf springs, prevents damage to the switch on the mechanism overtravel. If it should be necessary to change switch contacting time, bend rear heavy portion of switch operating arm. Do not bend leaf springs.

Latch Check Switch. The action of this switch may be checked as follows. Breaker being open, raise the trigger "Lift to Trip" arm to end of travel. Lower slowly, listening for snap action. Note position of arm when switch snaps closed. Switch should close when trigger arm is in interval $\frac{3}{8}$ to $\frac{1}{8}$ inch above normal reset rest position measuring at the shunt trip plunger centerline. A convenient method of measuring this is to raise and lower trigger arm by pushing with the trip plunger and making pencil marks on the plunger rod. If breaker is out of cell, switch action may be indicated electrically from drawout plugs number 17 and 18. If switch action must be made earlier or later, bend switch arm near the middle of its length.

CONTACT ADJUSTMENT

Four designs of contacts are shown in "a", "b", "c" and "d" of Fig. 6 on page 11. The different designs are used on different ratings. Compare the breaker to be adjusted with the four views in Fig. 6 and choose the one which applies.

Fig. 6-a. In this design, bridge contacts are resiliently attached to the moving contact arm by means of two studs with adjustable nuts behind the moving arm. The three sets of contacts, main, intermediate and arcing part in that order, and when closing, touch in the reverse order.

The main contacts are made from a silver-nickel alloy. The intermediate and arcing contacts are made from a tungsten silver alloy, which has high resistance to erosion by the arc. The stationary intermediate and arcing contacts are brazed to a casting mounted on springs on the upper bushing. The casting is connected to the bushing by a flexible shunt, and is supported between guide plates with stop surfaces so arranged that on breaker opening motion the arcing contact follows the moving contact farther and thus parts last.

In addition to the contacts, the moving contact arm also carries the puffer which supplies a puff of air through the nozzle under the moving arcing contact each time the breaker operates. This air serves to speed circuit interruption at low currents where the effect of the magnetic blow-out coils is lessened. It has no appreciable effect in opening high currents.

Arcing Contacts. To assure the proper compression in the arcing contact springs, these contacts should be adjusted so that, with the breaker closed, the dimension from the contact surface to the front surface of the stud block is between $1\frac{11}{16}$ and $1\frac{13}{16}$ inches. This adjustment is made by turning the nuts which attach the insulating operating rod to the crossbar.

When the contacts have been properly adjusted, the arcing contacts should touch on all three poles at approximately the same time in the closing stroke. It is satisfactory, if, when the first pole touches, the greater distance between arcing contacts on other two poles is not more than one-fourth inch.

Main Contacts. The main contact bridges are held in place on the moving contact arm by studs which pass through the main contact springs. Adjustment of the main contacts should be made after

arcing contacts have been adjusted. With the breaker in the closed latched position, set the stop nuts on these studs so that there will be one-sixteenth inch clearance between face of nut and the back of the moving contact arm.

If no clearance is present at these points, main contact pressure may be lacking or absent, thus forcing load current through the intermediate and arcing contacts. This can result in overheating and damage to the contacts. If new contacts are being installed or if the contacts have been smoothed, it is well to operate the breaker electrically several times so that the surfaces assume their permanent shape before this adjustment is made.

Fig. 6-b. In this contact design, the moving contact arm and the puffer cylinder are cast in one piece. The springs which apply pressure to the main moving contacts are hidden in a recess in the moving arm casting. In Fig. 6-b, note that there is an elongated hole, hidden from view, in each main contact bridge.

There is just one adjustment on this contact arrangement, namely the pushrod length. This length must be such that the pin through the contact bridges moves approximately $\frac{1}{16}$ inch from the end of the elongated hole in the bridge when breaker is closed and latched. To determine that adjustment is correct, measure relative motion of bridge into contact arm casting. With hand closing lever, move contact arms toward closed position until main contacts are just about to touch. Measure relation of bridge inner curved surface to machined edge of contact arm casting near pin. Close and latch contact. Repeat measurement. Bridge should move into contact arm $\frac{1}{16}$ inch. When necessary to readjust, change pushrod length by moving nuts at lower end of rod where it attaches to crossbar. Be careful to lock nuts tightly after finishing adjustment.

Fig. 6-c. In this contact design, the main moving contact is bolted solidly to the moving contact arm. All resilience is put in the stationary contact members. Conductivity from lower bushing to moving main contact is through a flexible shunt at contact arm hinge point. Lower main and upper main contacts are made of a high conductivity silver alloy. The arcing contacts are made of an arc refractory tungsten silver alloy.

The stationary arcing, and upper main contacts are brazed to a casting which is supported between

two guide plates which are part of the lower main stationary contacts. The upper main and arcing contact casting is connected to the bushing block by a flexible shunt and it is backed by contact pressure springs. The side plates carrying the lower main contact are pivoted at the upper mounting pin. At the lower pin hole, clearance is allowed so that plate may move giving some resilience to the lower main contact. The surface of the side plates next to the bushing block is silver plated as is the block. The plates are pressed against the block with springs on the mounting pins. Holes in the side plates engage small bosses on the stationary arcing contact casting to form stops for the casting so that the proper sequence in contact parting is obtained.

Side Plates. Two different designs of contact side plates have been supplied for the contact design shown in Fig. 6-c. (See Fig. 6-c, Details "X" and "Y"). Compare breaker being checked with X and Y of the detail. Note the difference in the shapes of the holes in these side plates. On Detail "X", the lower main contact should travel $\frac{1}{16}$ inch (minus zero, plus $\frac{1}{32}$). On Detail "Y", the lower main contact should travel $\frac{3}{32}$ inch (minus zero, plus $\frac{1}{32}$). Adjustment to get these travels is obtained by means of the nuts at the lower end of the operating rods. The arcing contacts of the three poles should touch at approximately the same time, but it will be satisfactory if, when the first pole touches, the greater distance at either of the other poles does not exceed $\frac{1}{4}$ inch. Correct main contact travel is more important than simultaneous touching of the three poles.

When replacement lower main contacts are ordered, they will be supplied on side plates as shown in Detail "Y". If original plates are like Detail "X", sufficient pieces should be ordered to change both sides on all poles of a breaker.

Fig. 2 on page 5 is a photo of the same contact assembly as that shown in Fig. 6-c. The contacts are in the closed and latched position. When the contacts open, the lower mains part first, then upper mains, and finally the arcing contacts part. When the contacts close, the arcing contacts touch first, then upper mains, and finally the lower mains.

Fig. 6-d. In this contact design, the moving contacts are solidly bolted to the moving contact arm. All resilience is put in the stationary contact member. Conductivity from lower bushing to moving main contact is through a flexible shunt at contact arm hinge point. Main contacts are of a high con-

ductivity silver alloy. Arcing contacts are made of an arc refractory tungsten silver alloy. The stationary arcing and main contacts are brazed to a casting which is supported between two guide plates that in this case are rigidly bolted to the bushing block. This stationary contact casting is connected to the bushing block with a flexible shunt and the casting is backed by contact pressure springs. Note that the travel of the stationary main contact should be $\frac{1}{8}$ inch plus or minus $\frac{1}{32}$. Adjustment for this is obtained by means of the nuts at the lower end of the operating rods.

ARC CHUTES AND BLOWOUT MAGNETS

The arc chute on the type DH air circuit breaker consists of an assembly of insulating refractory plates enclosed in a rectangular Micarta tube or jacket. In position on the breaker, the jacket is between the poles of the blowout magnet and the lower end is immediately above the arcing contacts.

The refractory plates have inverted V-shaped slots starting immediately over the arcing contacts so that the arc is drawn into these slots. The slots in the plates are alternately off center on opposite sides to increase the length of the arc path as the arc progresses up the chute.

Inside the front and rear surfaces of the chute are metallic arcing horns to which the arc transfers from the arcing contacts. The front horn is connected electrically to the moving contact, the rear horn through the blowout coil to the stationary contact. Thus when the arc transfers to the horns the blowout coil is included in the circuit.

The action of the breaker in interrupting an arc is shown in Fig. 7. When the arcing contacts separate, an arc is drawn between them without the blowout coil carrying current as indicated by position 1. The arc rises rapidly from this position under the influence of magnetic forces and thermal air currents. These cause the arc to impinge on the arcing horns, thus including the blowout coil in series with the arc.

When current starts to flow in the blowout coil, the arc is driven very rapidly into the slots in the refractory plates by the magnetic field. Successive positions of the arc are shown in Fig. 7.

Because the slots are staggered, the arc is lengthened as it progresses up the chute by being extended laterally from one slot to the next. This exposes a large part of the arc to the relatively cool surfaces of the plates and to the de-ionizing effect of the blowout magnet field, which results in fast and positive interruption of the circuit.

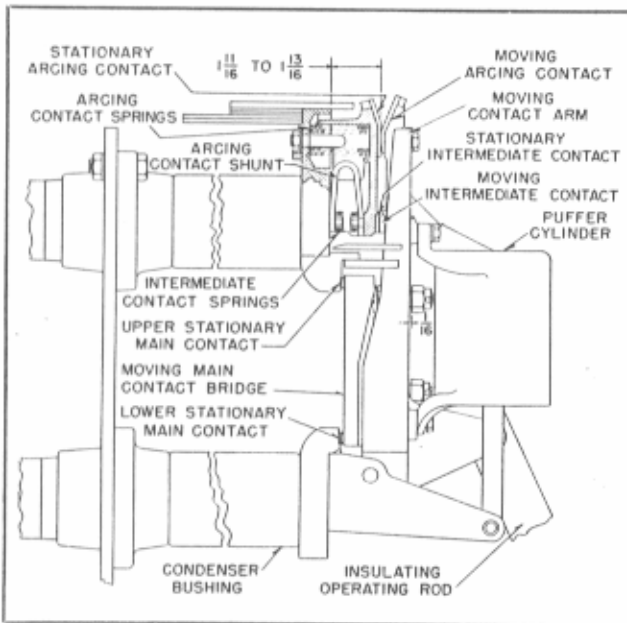


FIG. 6-a

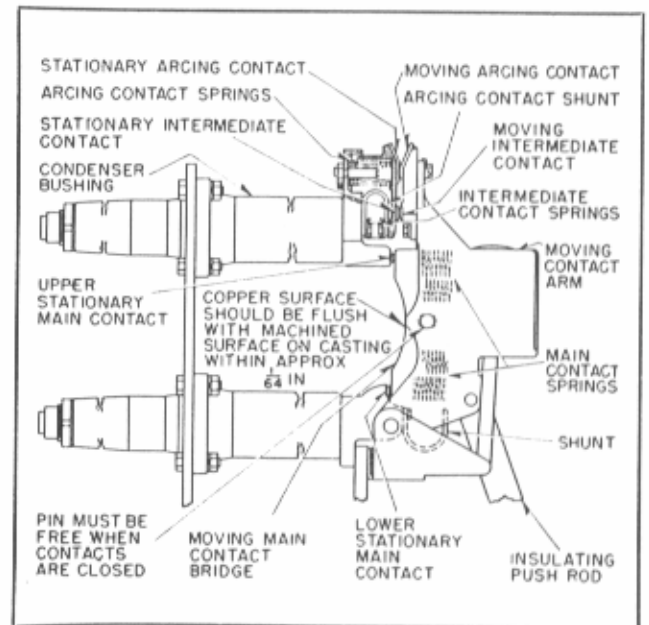


FIG. 6-b

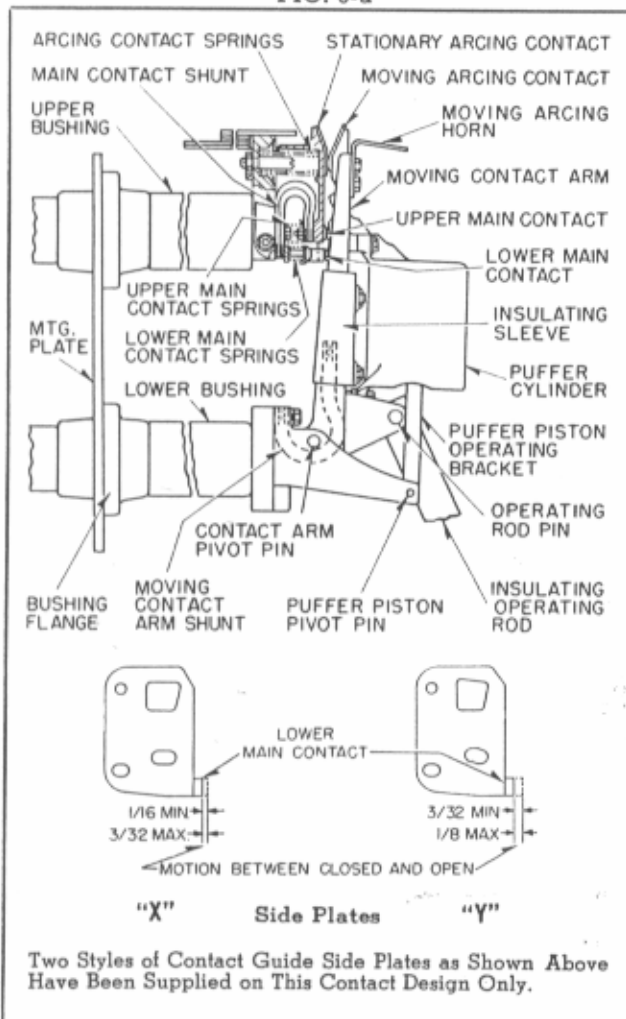


FIG. 6-c

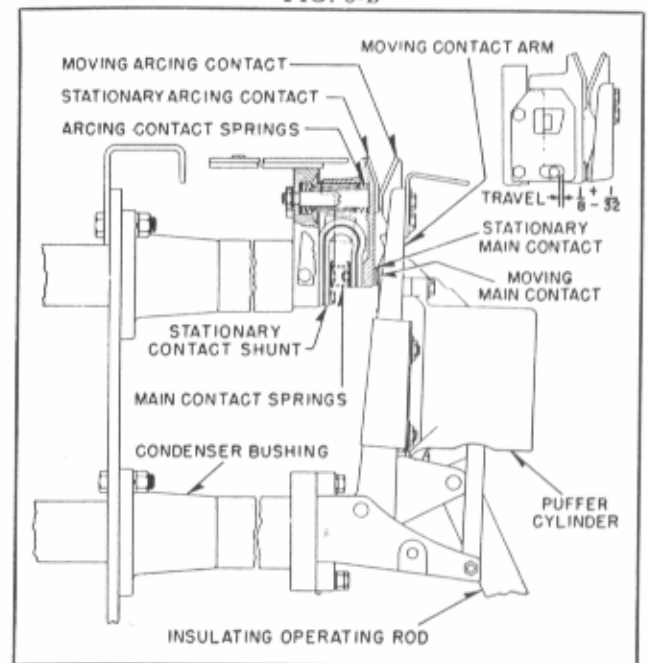


FIG. 6-d

FIG. 6. Contact Adjustment Dimensions for Four Different Breaker Contact Designs.

(Compare the breaker to be adjusted with the four views on this page and choose the one which applies.)

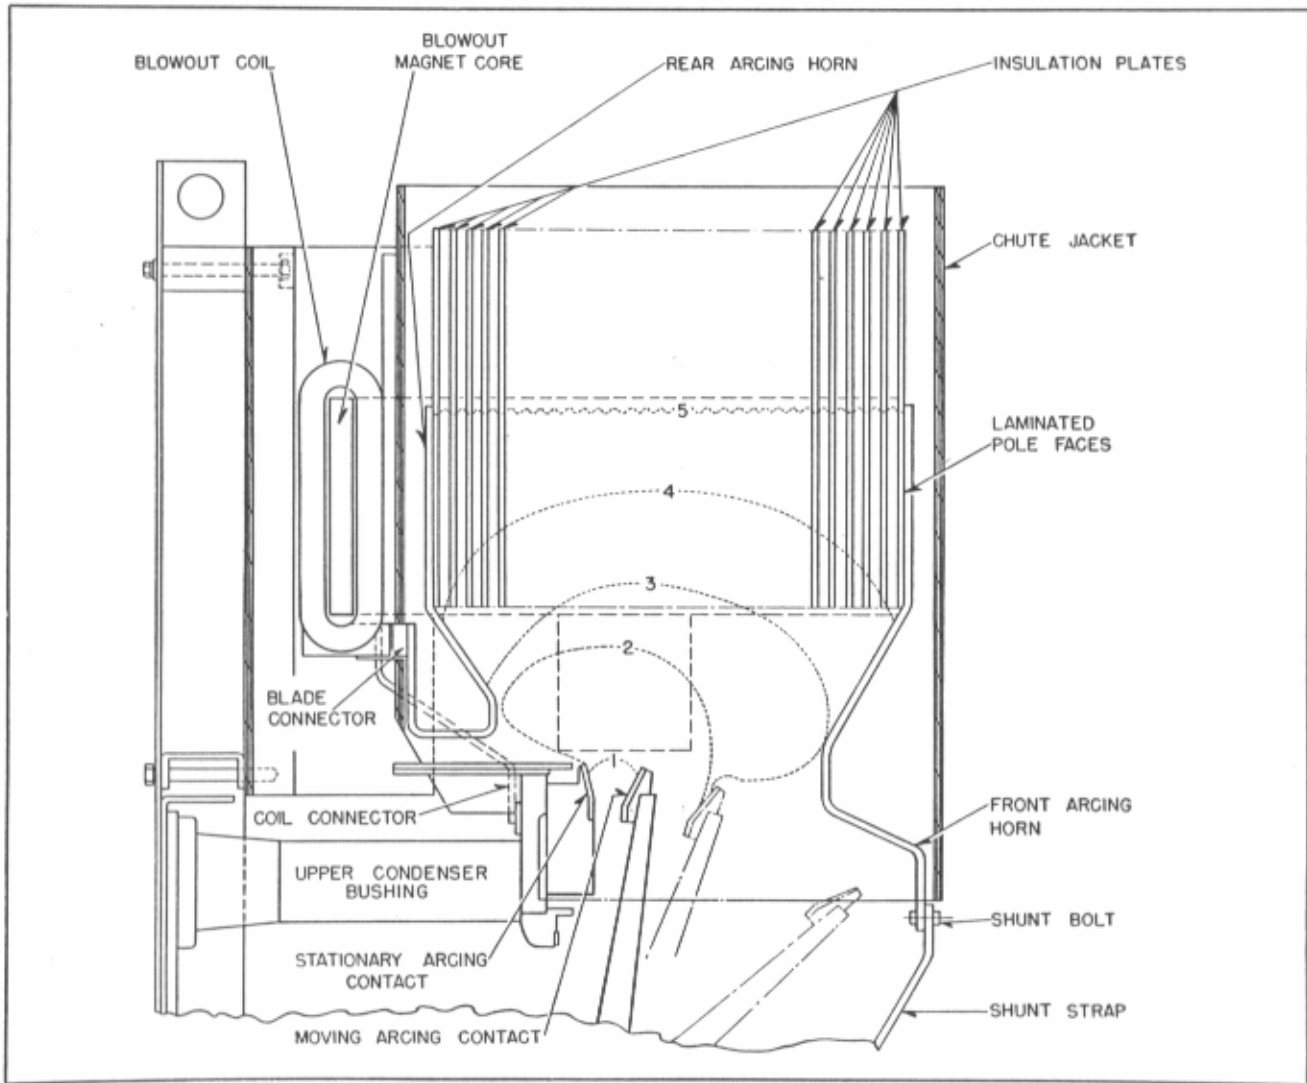


FIG. 7. Arc Chute and Blowout Coil.

HORIZONTAL DRAWOUT ARRANGEMENT

All type DH air circuit breakers are arranged or use in metal-clad equipment from which they may be drawn out horizontally. As may be seen in Fig. 9, all parts are supported on a steel frame with four wheels with roller bearings to facilitate moving the breaker, and flanges which engage with rails to align the breaker in the cell.

The main conductors project horizontally from the rear of the breaker, and are supported and insulated from the steel back plate of the frame by Micarta condenser bushings. On the ends of these main conductors are circular clusters of contact fingers arranged to engage the circular bar conductors in the cell.

The control circuit wiring also is arranged for drawout disconnection by means of an 18-point

connector block arranged to plug into a mating block mounted on the cell. This secondary connector block is mounted on a movable bracket on

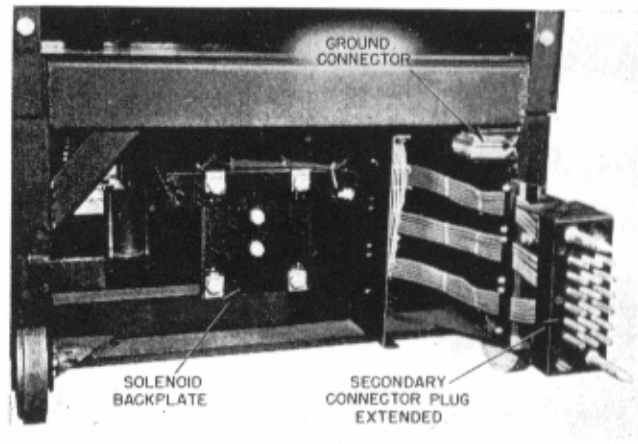


FIG. 8. Secondary Connector Plug Extended

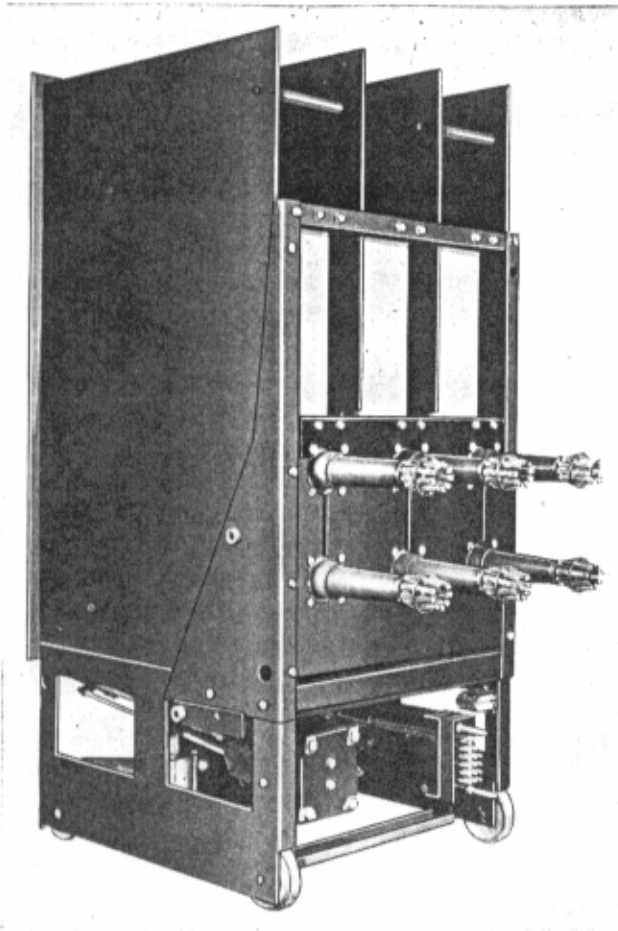


FIG. 9. Rear View of 150-DH-250 Circuit Breaker.

the lower left-hand side of the breaker frame. This permits the plug-in connector to be extended to the rear of its normal position so that the control circuits may be connected and the breaker operated electrically while the main contacts are disengaged. See Fig. 8.

This test position occurs at the outer limit of breaker travel obtained by operation of the levering-in device crank. If it is desired to connect the control circuits when the breaker has been cranked to this position, pull out the secondary contact locking pin shown in Fig. 4. While holding this pin out, push the secondary contact bracket toward the rear of the breaker until the secondary contacts engage fully. The main barriers may be removed and the breaker operated safely in this position since the main contacts are disconnected.

When the breaker is in the cell far enough to be connected to the high voltage bus, the frame work of the breaker is effectively grounded by a special connector located immediately above or below the secondary plug-in connector block. This connector

jaw engages a copper bar which is mounted in the cell and connected to the cell ground bus.

Levering-In Device. In order to move the breaker in or out of the cell against the resistance of the contact fingers, a levering-in device is provided on each breaker. There is a lever on each side mounted on a common shaft across the back of the breaker. On each lever is a roller which engages a groove on the side wall of the cell. A removable crank engages another shaft at the right front corner of the breaker which turns the levers through a worm gear arrangement.

Before a breaker is rolled into a cell, the levers with rollers at each side of the breaker must be at their rear and slightly down position as shown in Fig. 10. The position of the levers shown in Fig. 9 is that which the levers take after the breaker is cranked into operating position. To put the levers in the position shown in Fig. 10, place the crank on the operating shaft at front right corner of breaker. Press in and rotate to engage slot. Breaker must be open to engage slot. Rotate crank counterclockwise to the end of travel against solid stop. With levers

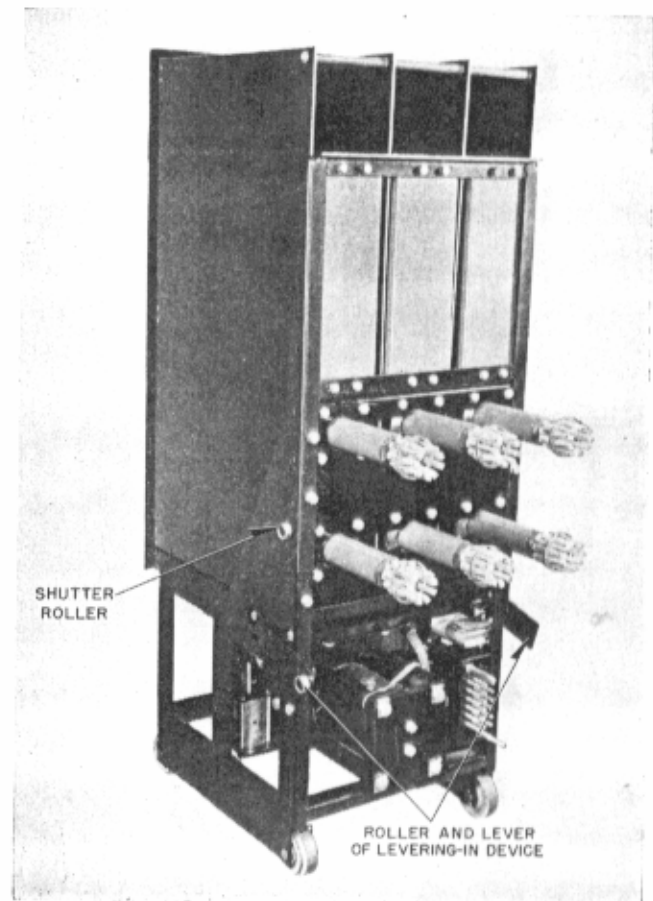


FIG. 10. Rear View of 50-DH-250D Breaker Ready to Roll Into Cell

to the rear and down as in Fig. 10 the breaker is ready to be rolled into cell as far as the test position. The rollers on the levers strike a vertical angle on the cell wall and stop the breaker at the test position. If the breaker is to be operated at this position, remove the crank, and push in the secondary control connector as previously described.

To move breaker from test position into fully engaged operating position, put crank on shaft. Push in and rotate to engage. Crank clockwise. Torque required will increase slightly when primary connector fingers engage the stud in the cell. Continue cranking until lever shaft meets solid stop.

Remove crank. If the cranking operation was completed, removal of the crank will permit the interlock pin, see Fig. 5 (also "A", Fig. 36 in I.B. 32-150-4), to withdraw from the trip-free lever in the mechanism.

To remove a breaker from operating position, first check that breaker has been opened. Put crank on operating shaft. Push and rotate to engage. Turn counterclockwise until stop is reached. Remove crank. Again the interlock pin will withdraw from the trip-free lever if the cranking operation was completed. Breaker may now be operated at the test position or rolled out of cell.

MAINTENANCE

Westinghouse type DH air circuit breakers are designed to have a long life with a minimum of maintenance when operating duty is ordinary or average. However, the operating duty will vary greatly as to frequency of operation and as to size and power factor of current interrupted, with the many types of applications of these breakers. Therefore, the frequency of inspection and the amount of maintenance for any particular application must be chosen with due regard to the kind of duty a breaker is performing. The following remarks are intended as a general guide. Experience on a particular application may show a need for different maintenance practices.

Breakers which operate only a few times per year with light to medium currents being interrupted, will require only light routine maintenance. This maintenance should consist of a general inspection and a cleaning of deposited dust and dirt particularly from insulation surfaces, and a few "exercising" operations. When making these exercising operations, observe the mechanical motions to be sure they are quick, snappy, and positive and that there is no tendency of any parts to stick. If there is any stickiness or sluggish motion, operate slowly by hand to locate the place with high friction. See paragraphs on "Lubrication", page 17. It is recommended that breakers which remain closed continuously without any automatic operations, be tried for proper operation at least once a year.

For breakers which operate a moderate number of times, say 100 to 1000 per year, mechanical stickiness is unlikely to develop and there will be no need for exercising operations. However, on inspections, more attention should be paid to clean-

liness of the interrupter especially if there are many fault current interruptions. Large current arcs glaze the ceramic surfaces inside the arc chute but leave them clean electrically. On the other hand, frequent operation at low or medium currents (about 1000 amperes or less) tends to cause the accumulation of soot and condensed metal on the parts inside the arc chute, particularly on the ceramic arc shields near the contacts. These deposits may be conducting and may have to be removed as explained later under "Arc Chutes".

Breakers which have opened large fault currents near the maximum rating, should be inspected as soon as practical. The condition of the contact surfaces and the contact pressure adjustments should be checked. (See page 15, "Contacts".) Also the interior of the arc chutes should be inspected for cleanliness, degree of erosion, etc.

For breakers, which operate very frequently such as those on motor starting and arc furnace switching, more maintenance will be required especially when breaker opens large fault currents as well as ordinary load currents. Until experience has been acquired on such an application, inspection should be scheduled at least every two months or every 2500 operations whichever comes sooner. At inspection, such breakers will need close checking of contact and mechanism wear. Also they may need cleaning in the arc chutes and re-adjustments in the mechanism.

ARC CHUTES

The insulating parts of the arc chute remain in the circuit across the contacts at all times. During the time that the contacts are open, these insulating

parts are subjected to the full potential across the breaker. Ability to withstand this potential depends upon the care given the insulation.

On general inspections blow out the arc chute with dry compressed air by directing the stream upward from the contact area and out through each of the slots between the arc splitter plates. Also direct the dry air stream thoroughly over the arc box shields. These are the ceramic liners in the lower end of the chute where the arc is drawn.

The arc chutes may be removed periodically for a thorough inspection. Remove any residue or dirt or arc products with a cloth or by a light sanding. Do not use a wire brush or emery cloth for this purpose because of the possibility of embedding conducting particles in the ceramic material.

When inspecting an arc chute, look for following:

1. Broken or Cracked Ceramic Parts. Small pieces broken out of ceramics, or small cracks are not important. But large breaks and particularly cracks from the inverted V slot in the interrupter plates out to the edge of the plate or to the top may interfere with proper performance of the interrupter. Hence if more than one or two broken or badly cracked plates are apparent, renewal of the ceramic stack is indicated.

2. Erosion of Ceramics. When an arc strikes the ceramic parts in the arc chute, the surface of the ceramic will be melted slightly. When solidified again, the surface will have a glazed whitish appearance. At low and medium currents, this effect is very slight. However large current arcs repeated many times may boil away appreciable amounts of the ceramic. When the width of the slot at its upper or narrow end (originally $\frac{1}{16}$) has been eroded to twice its original size, (or about $\frac{1}{8}$ inch) the ceramic stack assembly should be replaced.

3. Dirt in Arc Chute. In service the arc chute assembly will become dirty from three causes. First, dust deposited from the air can readily be blown out of the chute with a dry compressed air stream. Second, loose soot deposited on the inside surfaces of the arc chute in the lower portions near the contacts may be removed by wiping with cloths free of grease or metallic particles. Third, some deposits from the arc gasses will adhere very tightly to the ceramic arc shields near the contacts. These deposits from the metal vapors boiled out of the contacts and arc horn, may accumulate to a harmful amount only in breakers which get many operations at low or medium interrupted currents.

Cleaning Arc Shields. Cleaning methods for the first two types of dirt are obvious as mentioned

above. Particular attention should be paid also to any dirt on Micarta surfaces exposed to the arc below the ceramic arc shield. Wipe clean if possible. If wiping will not remove dirt, rub with sand paper and refinish these inside Micarta surfaces with Westinghouse red enamel No. 672 or equivalent. On breakers which get thousands of operations at low and medium interrupted currents, tightly adhering dirt may accumulate on the ceramic arc shields sufficiently to impair proper interrupting performance. This tightly adhering dirt can be removed only by rubbing with coarse sandpaper or other non-conducting abrasive paper. Doing this by hand inside the arc chute is slow and tedious. It is better to remove the ceramic arc shields from the arc chute and clean them with a power buffer or sander.

The ceramic arc shields may appear dirty and yet have sufficient dielectric strength. The following insulation test may be used as a guide in determining when this complete or major cleaning operation is required. 4.16 kv breaker arc chutes should withstand 15 kv, 60 cycles for one minute between front and rear arc horns. 7.2 and 13.8 kv breaker arc chutes should withstand 28 kv. Also the dirty surface of the ceramic near the contacts should withstand approximately 10 kv per inch when test prods are put directly onto the ceramic surface. When test voltage is applied, there should be no luminous display in the black deposits. If, after wiping and a light sanding in place, the ceramic surfaces will not withstand above insulation test, they should be removed and thoroughly cleaned with a power sander. While the ceramic arc shields or fire plates are out of the arc chute, the micarta surfaces behind them should be wiped clean, sanded lightly and refinished with Westinghouse No. 672 enamel.

After an arc chute has been replaced, inspect it to make certain that the contact of the rear arcing horn has engaged the connector on the blowout coil, that the upper edge of the jacket is substantially parallel to the magnetic pole faces, and that the front arcing horn is securely connected to the lower bushing by means of the shunt strap.

CONTACTS

In normal operation the arc will make terminal marks all over the arcing contacts and to a lesser extent on nearby metal parts. High current arcs will erode arc contact material more rapidly, but high current arcs move upward very quickly off the contacts. Low current arcs move very slowly and their terminals may hop around the arcing contacts

for several cycles. Hence a breaker which has had many operations at low currents, may be expected to have numerous small burned spots and pock marks all over the metal parts supporting the arcing contacts. When inspecting arcing contacts the important condition to be observed is the extent of the erosion of the contact material. When half of the original one eighth inch thickness has gone, the contact should be replaced. This is because the remaining $\frac{1}{16}$ inch thickness will be mechanically weak and might be broken away suddenly.

On high fault current operations there may be occasional slight burning on main contacts. Also after many operations, main contacts will sometimes become roughened. A fine flat file should be used lightly on the main contact silvers, removing only enough to take off the high spots. A moderate amount of pitting on the main contact surfaces will not appreciably impair their current-carrying ability because of the high contact pressure.

After contacts have been worn and dressed off as above, contact adjustments should be checked. See discussion on contact adjustment, page 9. Most re-adjusting will involve changing position of nuts at lower end of insulating operating rod to lengthen or shorten rod. Some mechanics may prefer to do this adjusting on the operating rod with the breaker in the closed position. If this is done, the danger in this practice should be understood and safety precautions taken. *The energy stored in the contact and opening springs can very easily lead to severe personal injury if breaker is accidentally tripped while head or hands are near the moving parts. Therefore, a safety block or guard should be put on the breaker to stop the contact arms early in the opening stroke.*

On 4.16 kv breakers, adjustment of the center pole is made in a slightly different manner. On some breakers a special tapped block is used on the lower side of the cross bar instead of a standard nut. Adjustment is made by removing the pin at the upper end of the operating rod, loosening the nut on the upper side of the cross bar, and then turning the operating rod. Tighten upper nut each time adjustment is checked. When satisfactory adjustment is obtained, replace cotter pin at upper end of operating rod. On other breakers, a standard nut is used on the lower end of the operating rod below the cross bar. On these breakers close contacts part way with hand closing lever and insert a wood block under the cross bar to hold it about half way up to the closed position. The locking clips can then be readily opened and the nuts turned with open end wrenches. After satisfactory

adjustment has been obtained remember to reset locking clips.

ORGANIC INSULATION

Organic insulating materials are used in high voltage air circuit breakers for pole unit supports, operating rods, barriers, braces, arc chutes and similar purposes, where it has been found to be more suitable than porcelain. The material used on Westinghouse breakers is Micarta, which has a long established record for insulating and mechanical dependability. To ensure long continued electrical resistance, the Micarta surface is protected with high grade insulating varnish which may be either clear or pigmented, depending on the place of use and the apparatus design requirements.

The purpose of the varnish is to retard moisture absorption and to provide an easily cleaned surface. Like all other insulating surfaces, whether organic or inorganic, a varnished Micarta surface should receive periodic attention in order to maintain the insulation resistance at the highest possible value.

The objects of maintenance are two-fold, first to remove dust and other foreign air borne materials as well as chemical oxides which result from aging of the varnish, and second to make sure that the varnish provides a continuous protective film over the entire insulating surface.

In addition to the usually recommended periodic equipment inspections, on breakers that have been in service for three to five years, the insulation should be inspected, cleaned, and the varnish renewed if the surface indicates it to be needed.

Cleaning. While the surface of the insulation is dry, contamination does not usually cause any large change in insulation value. However, if while it is present, moisture is added in the form of condensation, or by more direct means, the surface electrical leakage may be greatly increased, even to the point of electrical breakdown. The first object of maintenance therefore is cleaning. A clean varnished surface will be smooth, glossy, and free from foreign material either loose or adhering to the surface.

To obtain a clean surface, it is necessary to loosen the adhesive dirt by scrubbing and washing. This is best accomplished in the following manner:

1. Wash with normal heptane, obtainable from the major oil companies such as Esso Standard. Use clean paper towels wet in the heptane. Use a fresh towel on each part.

Caution: Heptane is inflammable and no open flames or sparks should be allowed near the work. Provide ample ventilation. Avoid long continued contact to skin by using neoprene gloves.

Normal heptane is recommended for this use because, (a) it will not harm the varnish, (b) it will quickly vaporize, (c) it will leave no residue which might tend to cause wetting action, and (d) it is practically non-toxic assuming good ventilation. If normal heptane is not available, any substitute should meet all above requirements. Acceptable substitutes are straight petroleum distillates such as mixed heptanes, white or non-leaded gasoline without benzol additives, Westinghouse solvent No. 1609-1, or -2, Stoddard solvent, mineral spirits, and cleaners' naphtha.

2. After the heptane has evaporated, which requires only a minute or two, wash with de-ionized water, sometimes called demineralized water, or distilled water.

Note: De-ionized or demineralized water can be obtained in small quantities from many firms that maintain chemical laboratories, particularly storage battery manufacturers or electroplaters.

Use fresh paper towels and keep the water in a handy size glass bottle. Wet the towel from the bottle, wash the part and dry immediately with a fresh towel. Use fresh towels for each part.

Inspection. When inspecting the insulating parts preparatory to cleaning, wipe off superficial dirt with a dry cloth and note the condition of the varnish and of the Micarta. If the varnish appears in good condition, i.e., fairly smooth and with liberal coverage, proceed with cleaning.

If the varnish appears thin, and is not uniform in coverage, is cracked, or can be peeled off with the fingernail, the parts should be revarnished.

Varnishing. Varnishing can be done with the parts in position on the breaker, as follows:

1. Sandpaper when needed to remove loose varnish and wipe off all dust from sanding.

2. Apply three coats of varnish, Westinghouse M#135-2. Allow 24 hours drying time between coats at ordinary temperatures. Drying time may be decreased by preheating parts with infrared lamps to a temperature of 40 to 50 degrees C before applying varnish and likewise heating each coat for about 4 to 8 hours, or until the varnish has set up to the point where it will not be lifted by applying the succeeding coat.

Laminated Insulation. Resin bonded laminated insulating materials are formed under pressure at high temperature. The release of pressure, reduction of temperature and some further shrinking of the resin bond produces internal stresses. Relieving of these stresses may result in the formation of minute cracks or checks along the laminated edges of the insulation. Such cracks, if small, are sealed by the varnish and are not harmful.

OPERATING MECHANISM

With average conditions, the breaker operating mechanism may be expected to operate 5000 times or more with only routine inspection and lubrication. During inspection the following points should be kept in mind. Remove loose dust and dirt with a compressed air stream. Wipe off latch and roller surfaces. With hand closing lever, move mechanism parts slowly closed to point where arcing contacts just touch, and then allow contact arms to fall slowly to open position, observing for any evidence of stickiness or excessive friction. Holding trigger up, move hand closing lever up and down slowly. The core should move freely in the solenoid and the linkage system should reset positively when weight of hand close lever is removed slowly.

Lubrication. If any excessive friction or binding is discovered on above inspection, relieve it either by adding oil or if necessary by cleaning old dried lubricant from bearing surfaces. In general, the addition of a few drops of oil should be sufficient in most cases. In a few cases, after long service, the accumulation of dried or oxidized lubricant may make it necessary to disassemble parts and clean them. Carbon tetrachloride is a good solvent for this.

Apply a small amount of a light oil to the wearing surfaces. Use a stable oil with a low rate of oxidation and with a low pour point. Wemco C is suggested. Avoid putting oil on insulating material surfaces. Also put no oil on the breaker contacts, nor on the auxiliary switch. Soft petrolatum may be used on the drawout connectors both primary and secondary. For the puffer pistons a few drops of Wemco C is recommended. Place the oil on cylinder walls, and spread around by operating a few times. For the air bumper, which has a bronze piston and rings in a brass cylinder, a small amount of graphite grease (W) 1022-1 is recommended. In dusty, dirty locations, surplus oil may catch and hold grit near bearings and latches and cause faster wear. In such locations, it is recommended that oil be omitted, and the steel parts in the mechanism be lubricated by rubbing with (W) Mol-kolube powder (# 8565-3).

MAINTENANCE

Clearances. After a mechanism has operated several thousand times, the following points should be checked as part of routine inspection. With breaker open and mechanism reset there should be $\frac{1}{32}$ to $\frac{1}{16}$ clearance from tripping latch roller to cam. If re-adjustment is necessary, see explanation under mechanism adjustments. To permit the closing latch to move up to its holding position the roller at the lower end of the non trip free lever must overtravel the latch surface slightly. With breaker closed, look thru the slot in panel with a flashlight at the closing latch and roller, and energize the close coil for one or two seconds several times.

The overtravel should be approximately $\frac{1}{32}$ minimum to $\frac{3}{32}$ maximum. With wear in the link holes and pins, this overtravel may decrease. Adjustment is made with steel shim washers between the magnet back plate and the four large magnetic return studs.

After about 15,000 operations, replacement of some parts may be required. During routine maintenance, the amount of wear should be observed on latch surfaces, rollers, pins and pin holes. If it becomes impossible to obtain correct adjustments or if latches fail to hold, replacements should be considered.

Renewal Parts. A list of renewal parts recommended to be kept in stock will be furnished upon request. When ordering renewal parts, specify the name of the part, and include all of the information given on the breaker nameplate.

WESTINGHOUSE	
METAL CLAD SWITCHGEAR	
DE-ION AIR CIRCUIT BREAKER DH	
STYLE OR SO	DATE OF MANUFACTURE
SERIAL	BREAKER UNIT & CODE
RATED KV	WILL FIT HOUSING CODE
MAX DESIGN KV	TYPE MECHANISM
AMPERES	CLOSING VOLTAGE
CYCLES	TRIPPING VOLTAGE
PATENTS 2442199 2276968 2243040 2243038 2242905 2177014 2039054 2029589	
WESTINGHOUSE ELECTRIC CORP. NP54068 B MADE IN U.S.A.	

SUPPLEMENTARY INSTRUCTIONS



AIR CIRCUIT BREAKER TYPE 150-DH-750

These supplementary instructions are to be used in conjunction with DH Breaker Instruction Book I.B. 32-150-3A. Only those features which are peculiar to the Type 150-DH-750 Air Circuit Breaker are covered by these instructions.

MARCH, 1957

WESTINGHOUSE ELECTRIC CORPORATION
ASSEMBLED SWITCHGEAR DEVICES

EAST PITTSBURGH PLANT

•

EAST PITTSBURGH, PA.

DESCRIPTION

The Type 150-DH-750 Air Circuit Breaker is a 3-pole, electrically operated, horizontal drawout unit for metal-clad switchgear. The rating of the breaker is as follows:

1. Interrupting rating	750 MVA
2. Continuous current at 60 cycles	1200 and 2000 amperes
3. Rated voltage	13.8 KV
4. Maximum design voltage	15.0 KV
5. Minimum voltage for rated interrupting capacity	11.5 KV
6. Interrupting current at rated voltage	31,500 amperes
7. Maximum interrupting current	37,500 amperes

Figure 1 shows the breaker with the main barrier assembly removed. This shows the arrangement of the center coil arc chutes, the contacts, and the solenoid operating mechanism.

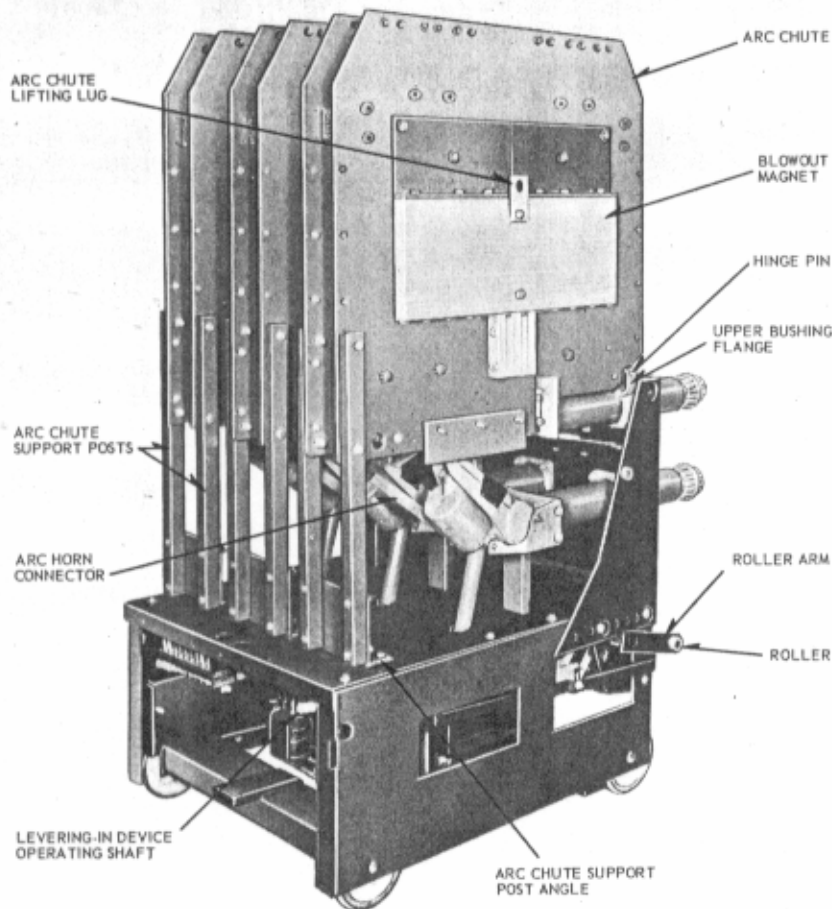


FIG. 1. 150-DH-750 CIRCUIT BREAKER WITH MAIN BARRIER REMOVED

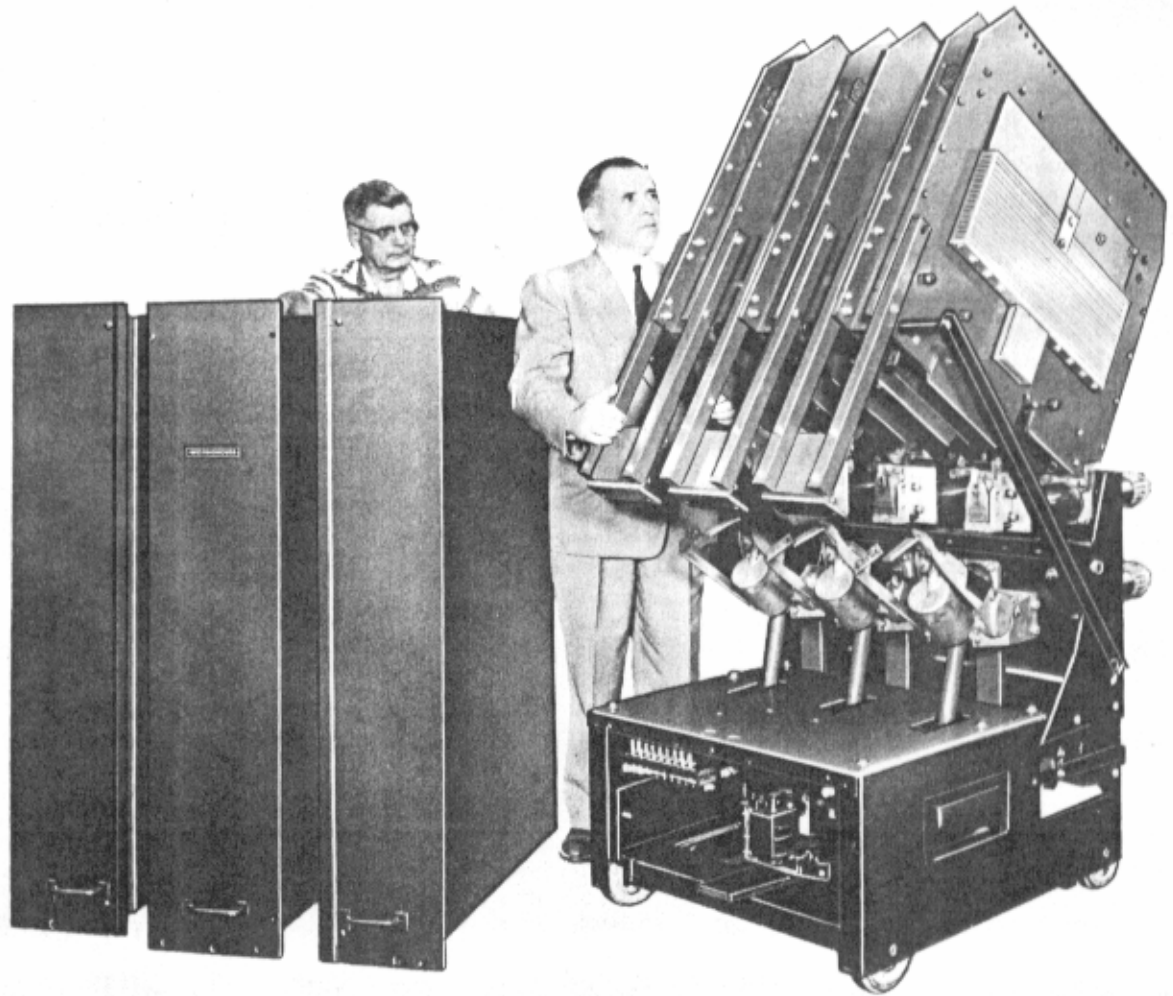


FIG. 2. TYPE 150-DH-750 CIRCUIT BREAKER WITH MAIN BARRIER REMOVED AND ARC CHUTES RAISED

These components are supported on a welded steel frame which is mounted on flanged wheels for driving it into the metal clad cell. In the lower part of the frame is also located the levering-in device for moving the breaker into final contact engagement. This device is interlocked with the mechanism to prevent inserting or withdrawing the breaker with the contacts closed. Also located in the lower part of the frame are the secondary contacts for automatically disconnecting the control wiring when the breaker is withdrawn, the auxiliary switch, and other auxiliary devices.

The arc chutes on this breaker are of the center coil design. In this type of construction, the magnetic circuit is H-shaped with the cross member of the H passing through the center of the arc chute. The blowout coils are wound around the cross member of the H and lie in the center of the arc chute.

With this type of construction, the magnetic core passing through the center of the arc chute, it is impossible to remove the arc chute from the magnet. To provide easy accessibility

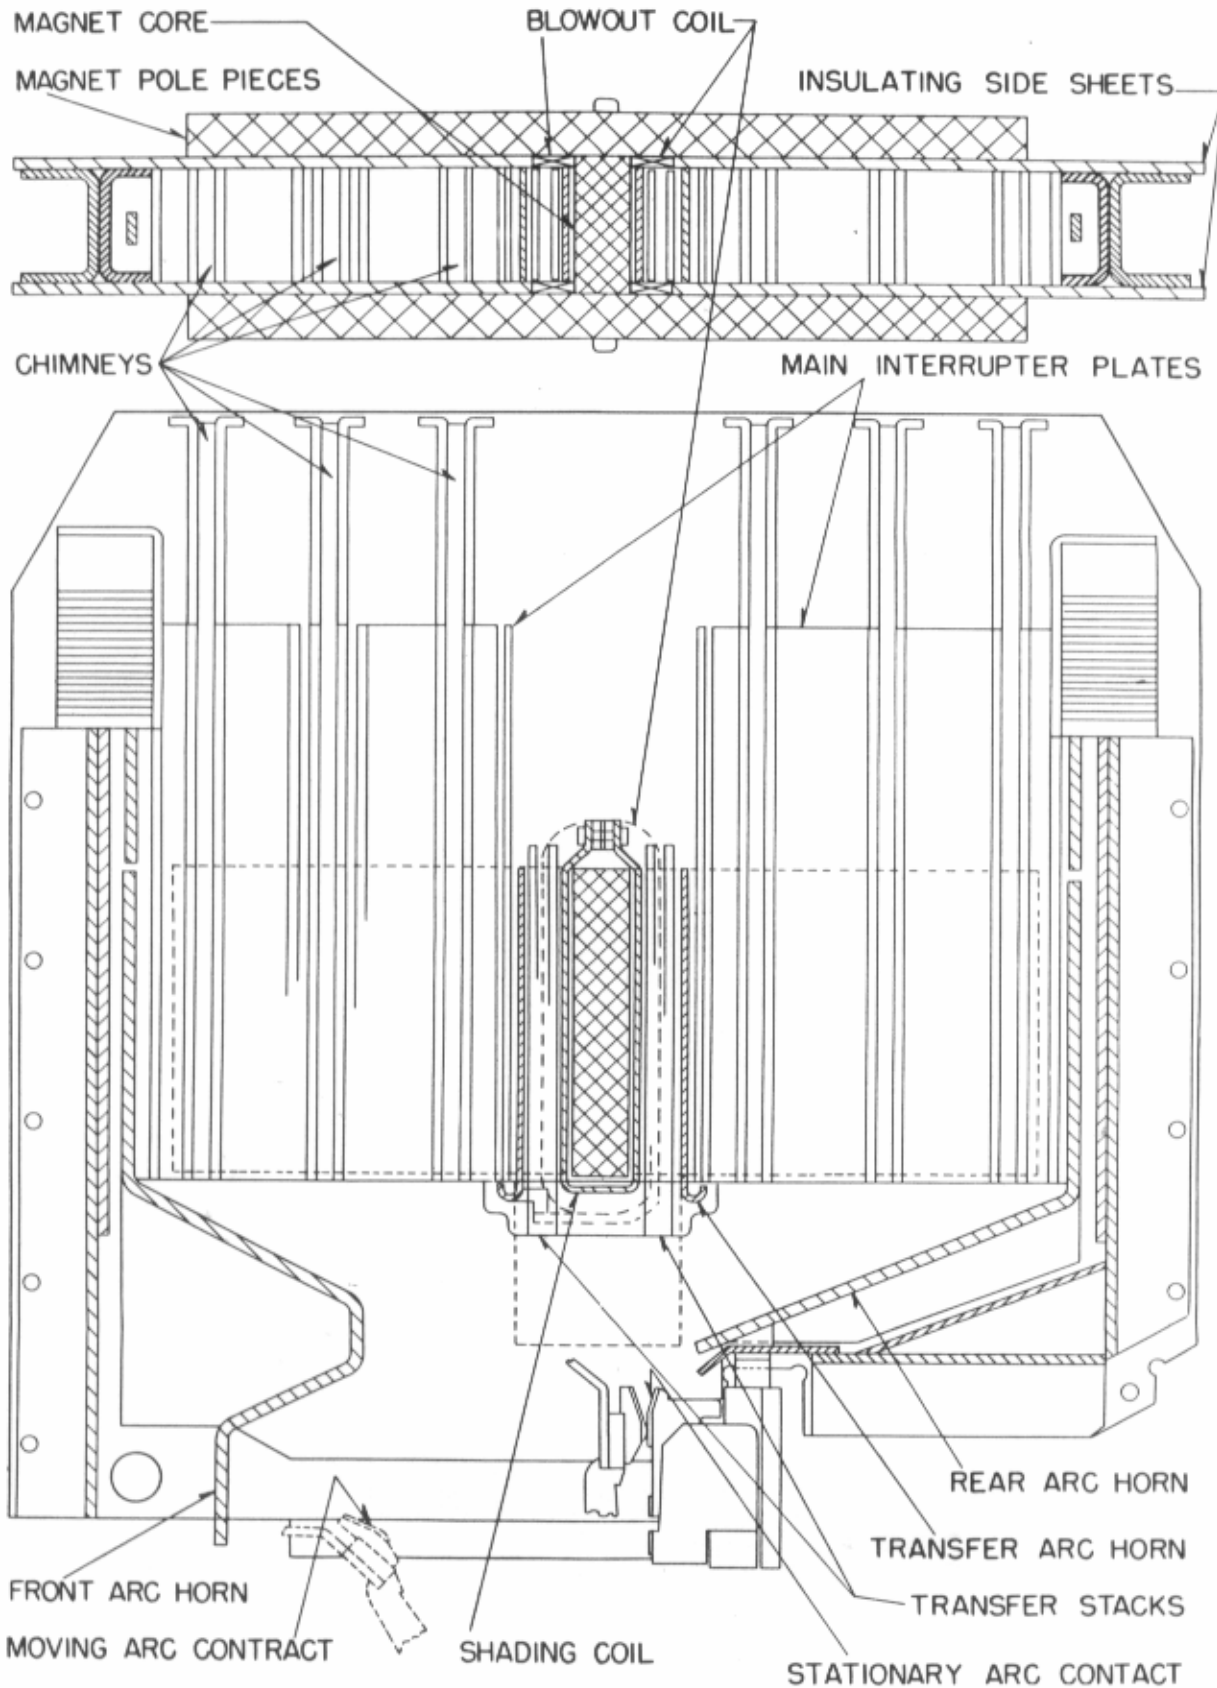


FIG. 3. SCHEMATIC CROSS-SECTION OF AN ARC CHUTE SHOWING COMPONENT PARTS

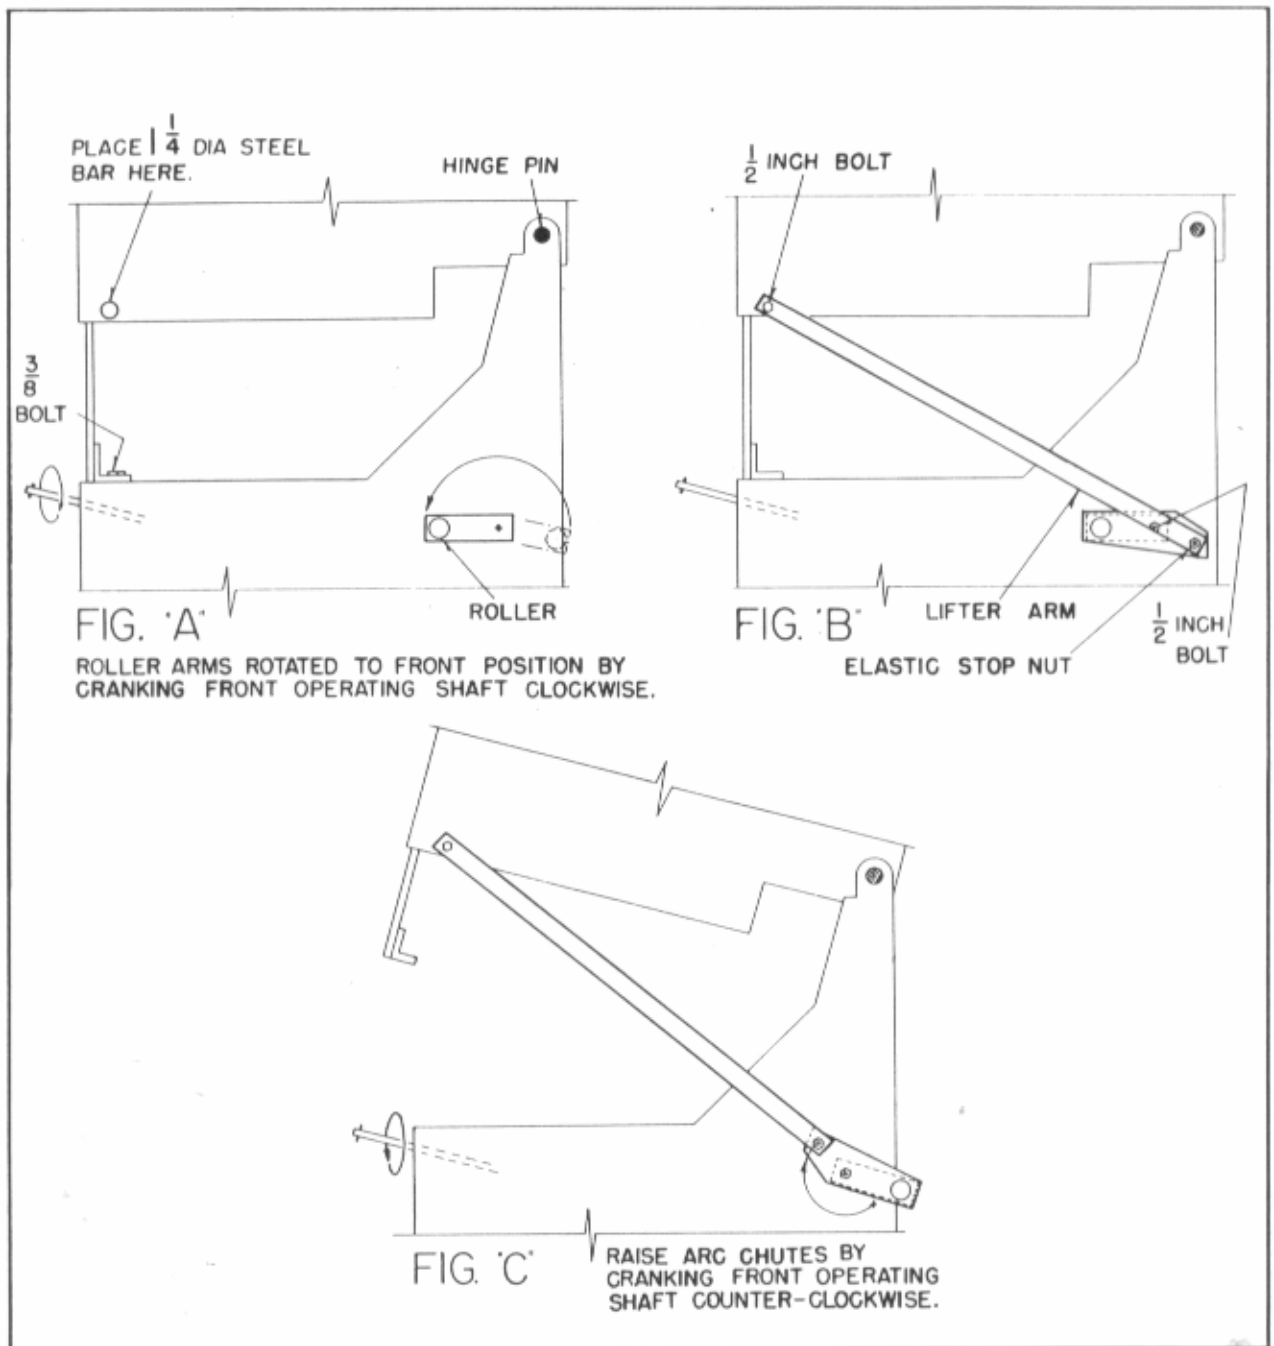


FIG. 4. ARC CHUTE LIFTING ARRANGEMENT

for contact maintenance and inspection, the arc chutes are hinged at the rear, and a simple tilting device is provided. Figure 2 shows the breaker with the arc chutes tilted back. The levering-in device is used to supply the mechanical advantage for tilting the arc chutes.

A barrier assembly is placed on the breaker before it is rolled into its cell. The front sheet is $\frac{1}{8}$ inch steel to form a grounded barrier between personnel and live parts when the

unit is in the cell. On the 150-DH-750 breakers, the barrier assembly is in three parts for convenience in handling.

RECEIVING, HANDLING AND STORING

The receiving, handling and storing of the 150-DH-750 breaker should be done in the manner set forth in the instruction book I.B. 32-150-3A. The approximate weight of the breaker and the various breaker parts is as follows.

Breaker Parts	1200 Amperes	2000 Amperes
Breaker without arc chute and barriers	1020 pounds	1240 pounds
Single arc chute	425 pounds	425 pounds
Barrier assembly	175 pounds	175 pounds
Complete breaker	2470 pounds	2690 pounds

INSTALLATION

With the exception of the arcing chambers and the barriers, these breakers are shipped completely assembled and adjusted. No adjustment should be required and none should be made unless obviously needed.

CAUTION: Severe injury may be sustained if any part of the body is struck by the contact arms since they move very rapidly in the opening stroke. Personnel working about the breaker should stay clear of the space in which the contact arms move while the breaker is closed or being closed. If breaker has been closed by hand, always remove hand closing lever before tripping.

The following sequence of operation should be performed in preparing the breaker for use:

1. Breakers are usually shipped with the contacts closed and with a tie on the trip lever to prevent tripping. After the breaker is unpacked and the shipping ties and braces removed, take off the tie on the trip lever and trip the breaker. Then close the breaker carefully by hand using the removable hand closing lever. Make certain that all parts are functioning properly in that there is no binding or excessive friction. As the contacts touch near the end of the closing stroke, the force necessary to close the breaker increases rapidly.
2. With the breaker in the closed position, check the contacts to make certain that the adjustments have not been disturbed. For proper settings, refer to Figure 6C and Section 6C under contact adjustments. If adjustments are required, they may be made as described in Page 9 and 10 of I.B. 32-150-3A. A light film of grease is applied to both the arcing and main contacts before the breaker is operated at the factory. This film is normally removed before shipment. Before the breaker is placed in service, inspect all contacts to see that they are free of oil or grease.

3. The breaker is more easily handled with the arc chutes and barriers removed. Mount these parts after the breaker has been moved near the metal clad cell structure. Before installing the arc chutes, play a stream of dry compressed air through them from each end to remove any dust or foreign matter. Then examine the chutes to make certain that the vents and slots are open.
4. Mount the arc chutes one at a time in the following manner:
 - a. Remove arc chute support posts from breaker frame by removing 2-3/8 bolts which fasten arc chute support post angles to breaker frame.
 - b. Lift the arc chutes by hooking on to the arc chute lifting lugs attached to the blow out magnet.
 - c. Mount the arc chute support posts with angles attached to the front of the arc chutes using the 3/8-16 x 2-1/4 bolts provided.
 - d. Remove the hinge pin from the upper bushing flange.
 - e. Lower arc chute into place so that back end is between hinge bracket on upper bushing flange. Use care in lining up the arc chute so that rear arc horn clip makes good contact with upper contact foot. Arc chutes support post angles will reset on the breaker frame.
 - f. Insert hinge pin and put cotter pins in place.
 - g. Fasten arc chute to breaker frame by replacing 3/8 bolts through support angles to breaker frame.
 - h. Bolt arc horn connector to front arc horn in the chute.
 - i. Tighten lower connection of arc horn connector since it may have come loose during shipment.
 - j. Make final check by operating breaker slowly by hand, and see that there is no interference with the movement of the contacts.
5. The interphase barrier should now be put in place. Because of the size and weight, the barrier assembly is divided into three parts. The center part goes on first and is aligned by the two locating pins on the breaker frame. A single bolt in the center holds it in place. The two outside sections mount next. Make sure the lower rear corner of the Micarta plate goes to the inside of the steel gussets on the breaker frame. These two parts are aligned by locating pins in the lower front corners and bolts to the center barrier. Two bolts at the lower front corners hold these assemblies in place.
6. The breaker is now ready to be operated electrically. Each breaker should be closed and tripped electrically several times before being connected to high voltage. These operations may be made at the test position in the cell or by means of other test facilities provided. See Page 12 of I.B. 32-150-3A and Page 33 of I.B. 32-150-4, for information concerning placing the breaker in the cell. The hand closing lever must be always removed from the socket in the mechanism before making electrical

operations. If electrical operation is quick and positive on both the close and trip, the breaker is now ready to be levered into the operating position.

CAUTION: Do not attempt to close the 150-DH-750 breaker by hand against an energized circuit. To insure sufficient closing force and speed, the breaker should be closed electrically from an adequate power source. See NEMA standard SG-6-213.

When this breaker is put into the cell and moved in beyond the test position, the high voltage parts will be energized. If the barrier is completely assembled on the breaker, personnel will be protected from contact with the live parts. If however, the barrier assembly is left off and the breaker rolled into the cell, live parts are exposed. The breaker never should be rolled into an energized cell structure beyond the test position without having the complete barrier assembly in place.

OPERATION AND ADJUSTMENT

The operation and adjustments of the breaker is the same as that for the breakers described in I.B. 32-150-3A. Reference should be made to Pages 6 through 8 of the I.B. for information covering the Mechanism, Mechanism Panel with its associated tripping device and auxiliaries, and Mechanism Adjustments.

CONTACT ADJUSTMENT

The contacts on this breaker are the same as those described in the section referred to as 6C, Page 9, in the instruction book. Any adjustments that are necessary should be made as outlined in that section. The side plates are similar to that shown in detail "Y" of Figure 6C, Page 11.

ARC CHUTES

The arc chute consists of an H-shaped blowout magnet, blowout coils, transfer arc horns, transfer stacks, main interrupter stacks, a front arc horn, and a rear arc horn, all assembled in and about a fabricated rectangular Micarta chute jacket. The arc chute is hinged to the breaker and when it is in the normal position, its lower end completely surrounds the contact structure. Figure 3 is a schematic cross section of the arc chute showing the component parts.

The blowout magnet is located so that the magnetic core passes through the center of the arc chute. The blowout coils are wound about the core and lie in windows cut in the chute jackets side sheets. One terminal of each coil connects to a transfer arc horn and the other terminals are joined together with the shading coil. Two transfer stacks are placed in the space between the transfer arc horns and the shading coil. To either side of the transfer arc horns are the main interrupter stacks which are made up of a series of insulating refractory plates. These plates have inverted V-shaped slots molded into them. The slots are off set so that when the plates are stacked with the slots alternating from one side to the other, the arc must take a serpentine path as it moves up into the arc chute, thus increasing the length of the arc.

To either side of the main interrupter stacks are two metallic arc horns to which the arc transfers from the arcing contacts. The front arc horn is connected electrically to the moving contact, and the rear arc horns is connected to the stationary contact.

The action of the breaker in interrupting an arc is as follows: Referring to Figure 3, when the arcing contacts part and an arc is drawn, it loops up and impinges on the lower ends of the two transfer arc horns and the shading coil. The two short segments of arc from the transfer arc horns to the shading coil then move up into the transfer stacks and are quickly interrupted placing the blowout coil in series with the arc.

When the current starts to flow in the blowout coils, a magnetic field is established and the arc, which by this time is two separate arcs, extending from the two end arc horns to the transfer horns, is driven very rapidly up into the slots of the refractory plates. As the arc moves to the closed end of the slots, it is restricted, lengthened, cooled, and subject to a strong magnetically induced blast of gas. All of these forces result in rapid "de-ionization" of the arc space, and for the arc to maintain itself it must continually ionize fresh gas. At current zero the formation of new ionization momentarily ceases, but the de-ionization continues so that dielectric strength is established in the arc space and the circuit is interrupted.

ARC CHUTE LIFTER

In order to raise the arc chutes for contact inspection and maintenance, an arc chute lifter is provided. This is an attachment which uses the mechanical advantage of the levering-in device to provide the lifting force.

Before attempting to use the arc chute lifter, it would be well to become familiar with the operation of the levering-in device as set forth in Pages 13 and 14 of I.B. 32-150-3A. The following steps may then be followed in raising or lowering the arc chutes.

To raise the arc chutes refer to Figure 4 and proceed as follows:

1. Remove barrier assembly.
2. Place crank on levering-in device operating shaft and rotate clockwise so that arms at each side of the breaker are pointed to the front of breaker as shown in Figure 4-A.
3. Remove six 3/8 bolts from Micarta arc chute support angles.
4. Place 1-1/4 diameter steel bar through large holes in front of arc chutes.
5. Remove 1/2 inch bolts which fasten triangular plates to arc chute lifter arms.
6. Place large hole of triangular plate over roller on levering-in device arm and bolt plate to levering-in shaft with 1/2 inch bolt in position shown in Figure 4-B.
7. Repeat steps 5 and 6 fastening other arm and plate to opposite side of breaker.
8. Remove 1/2 inch bolts from either end of 1-1/4 diameter bar through arc chutes and fasten free end of lifter arms to the bar using the 1/2 inch bolts.
9. Disconnect shunt straps from front arc horn.
10. Place crank on levering-in operating shaft and rotate counter clockwise to raise the arc chute to position shown in Figure 4-C.

It is important that the arc chutes be raised until the indicator on the front of the breaker shows that the full travel of the levering-in device has been used. This releases the mechanism interlock and permits the breaker to be closed and tripped either electrically or manually with the arc chutes in the raised position.

To lower the arc chutes and prepare the breaker for return to service, repeat the steps 1 to 10 in reverse order.

CAUTION: After inspecting the contacts and arc chutes and before returning the breaker to service, make certain that the shunt connection to the front arc horns is bolted tight.

HORIZONTAL DRAWOUT ARRANGEMENT

The 150-DH-750 is arranged for use in horizontal drawout metal clad equipment and any questions pertaining to this arrangement, which includes operation of the breaker levering-in device, should be referred to I.B. 32-150-3A Pages 12 through 14.

MAINTENANCE

For maintenance procedure on the 150-DH-750 air circuit breaker, refer to I.B. 32-150-3A, Pages 14 through 18.